

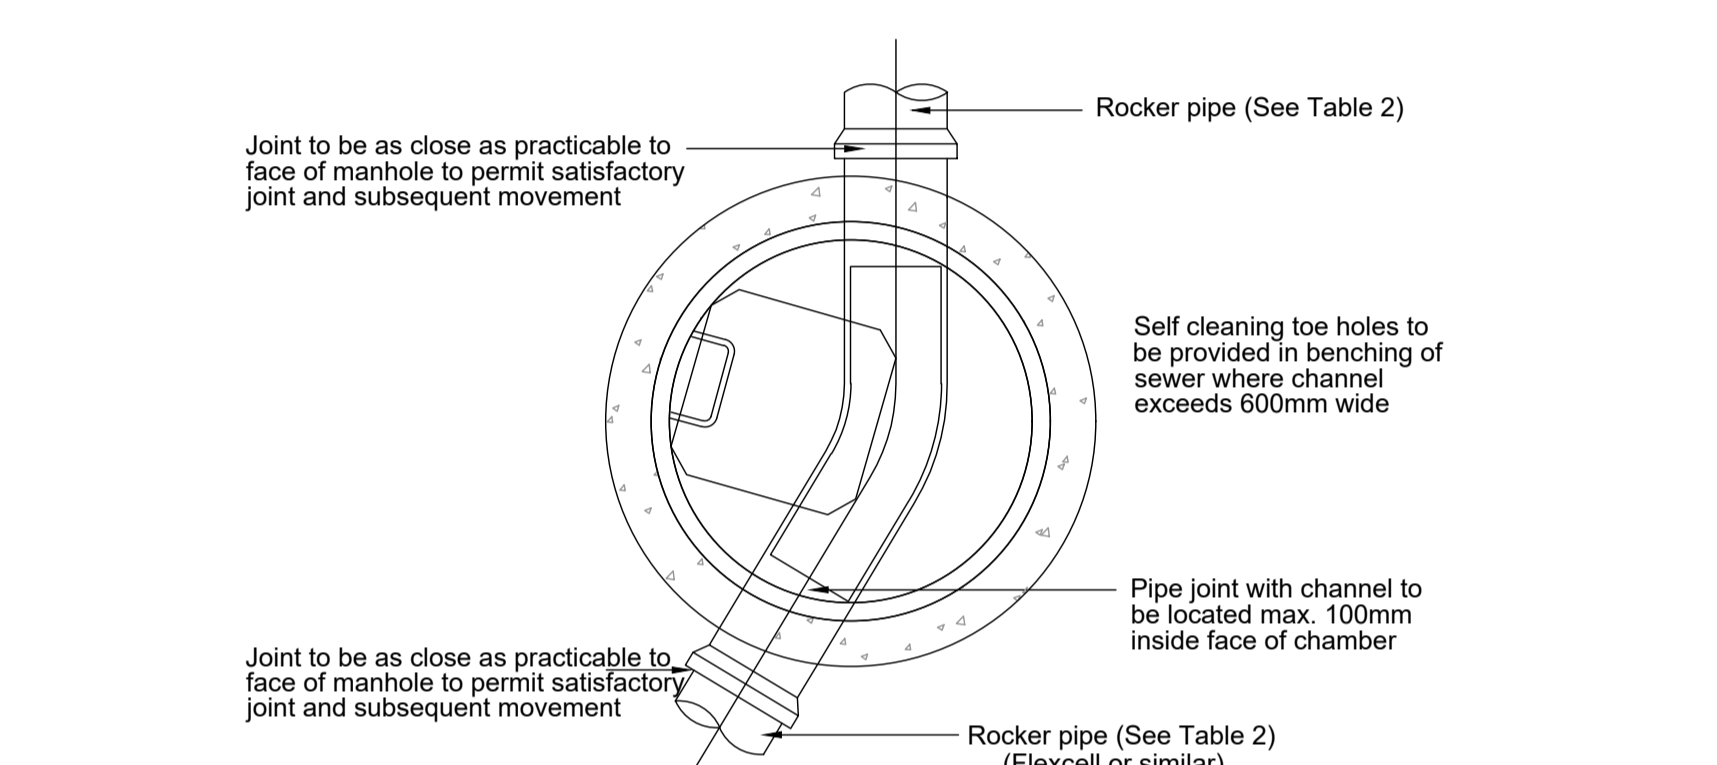
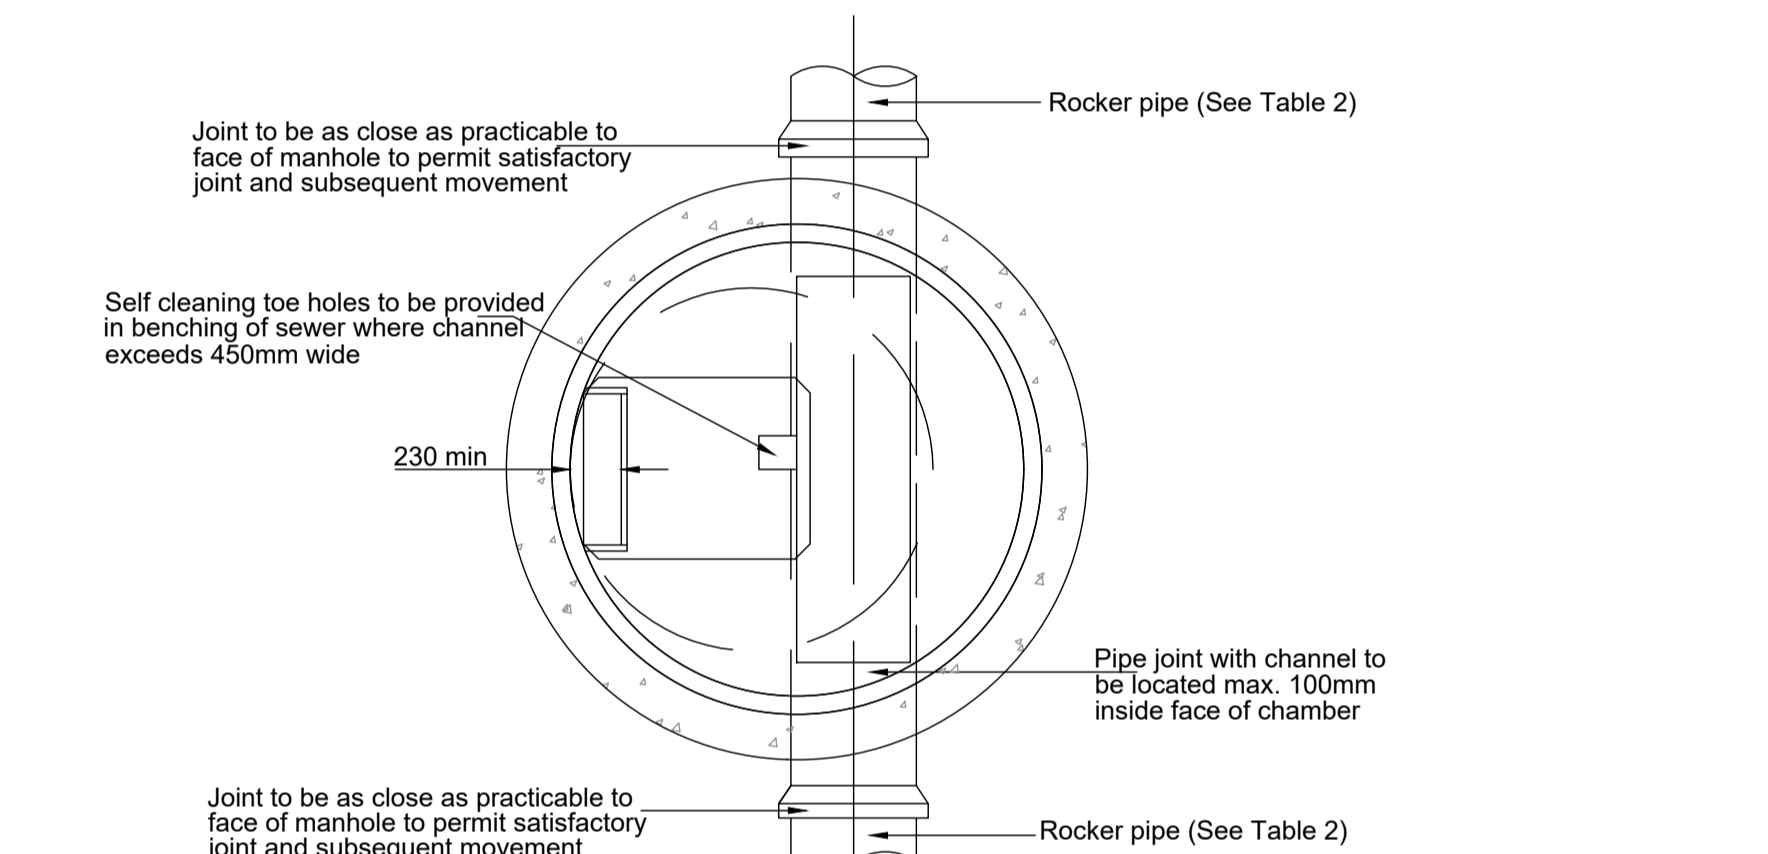
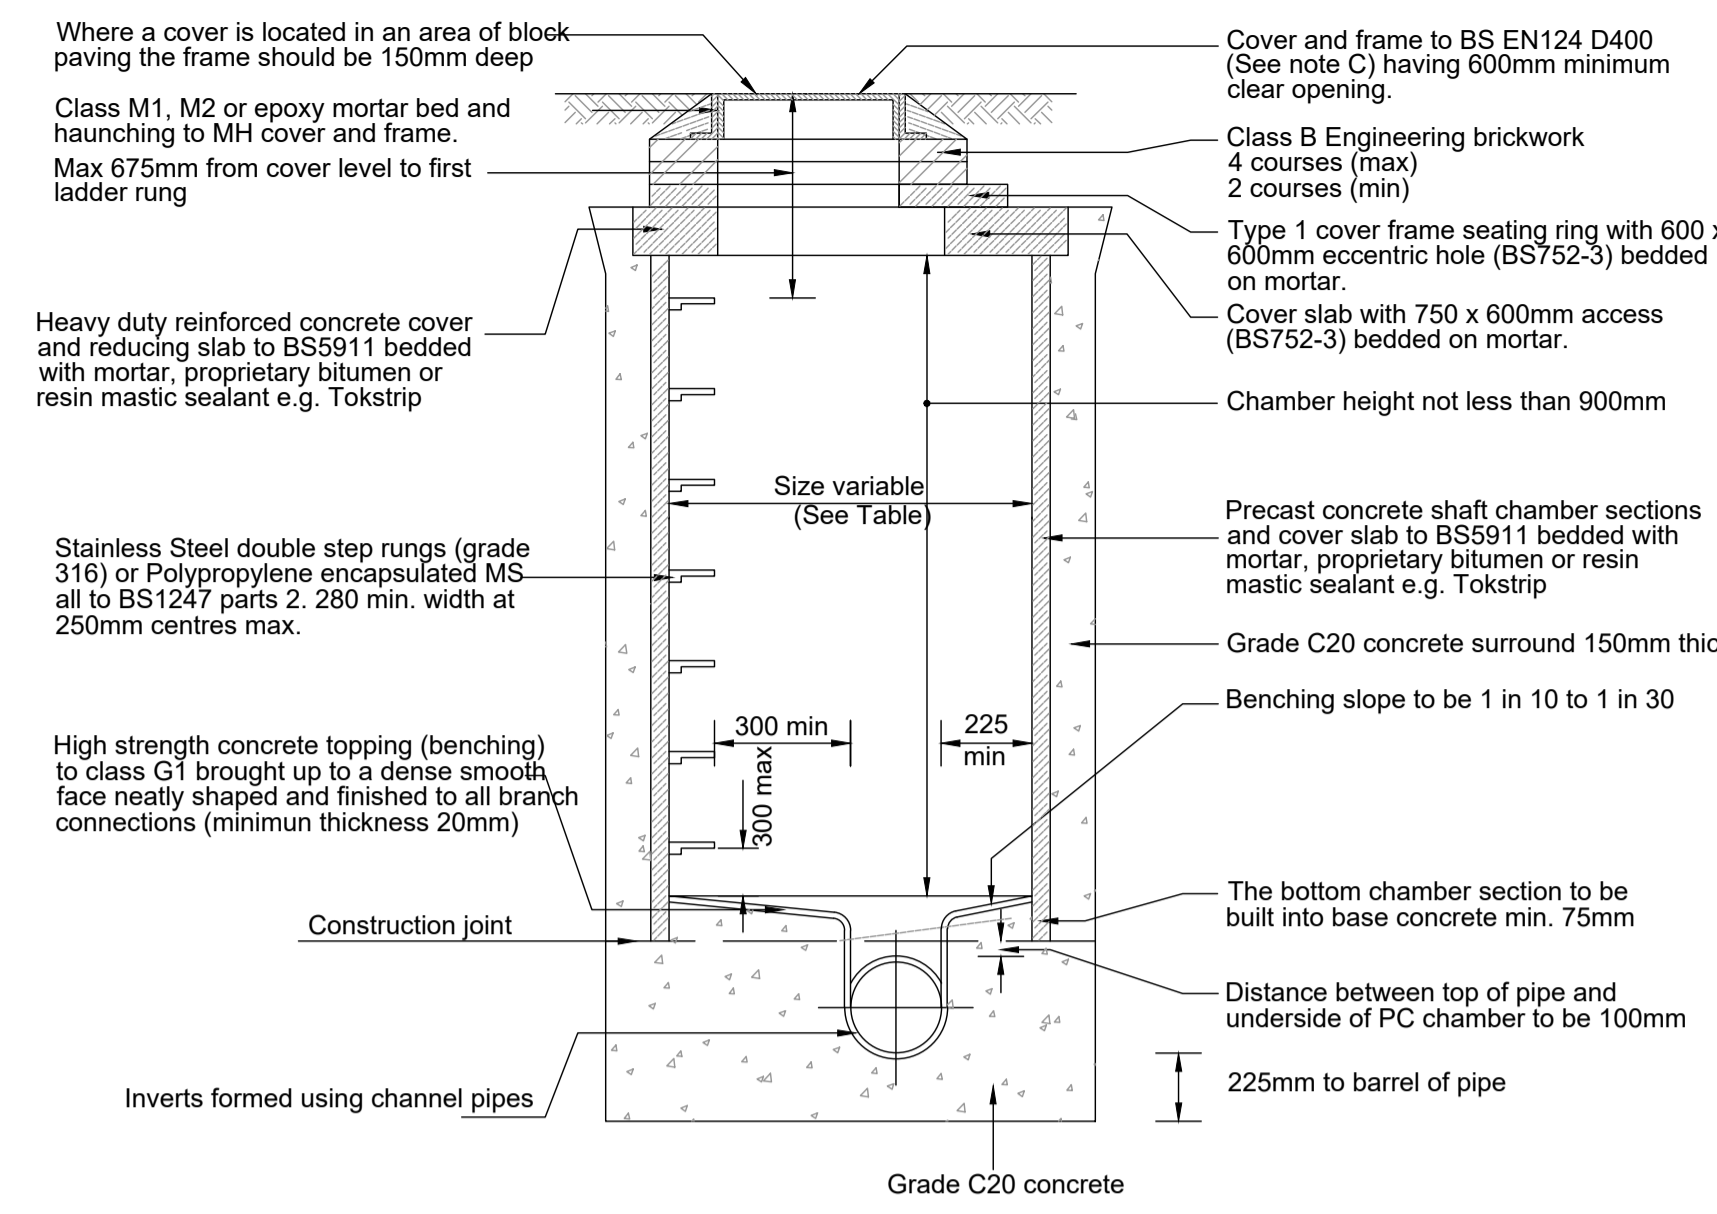
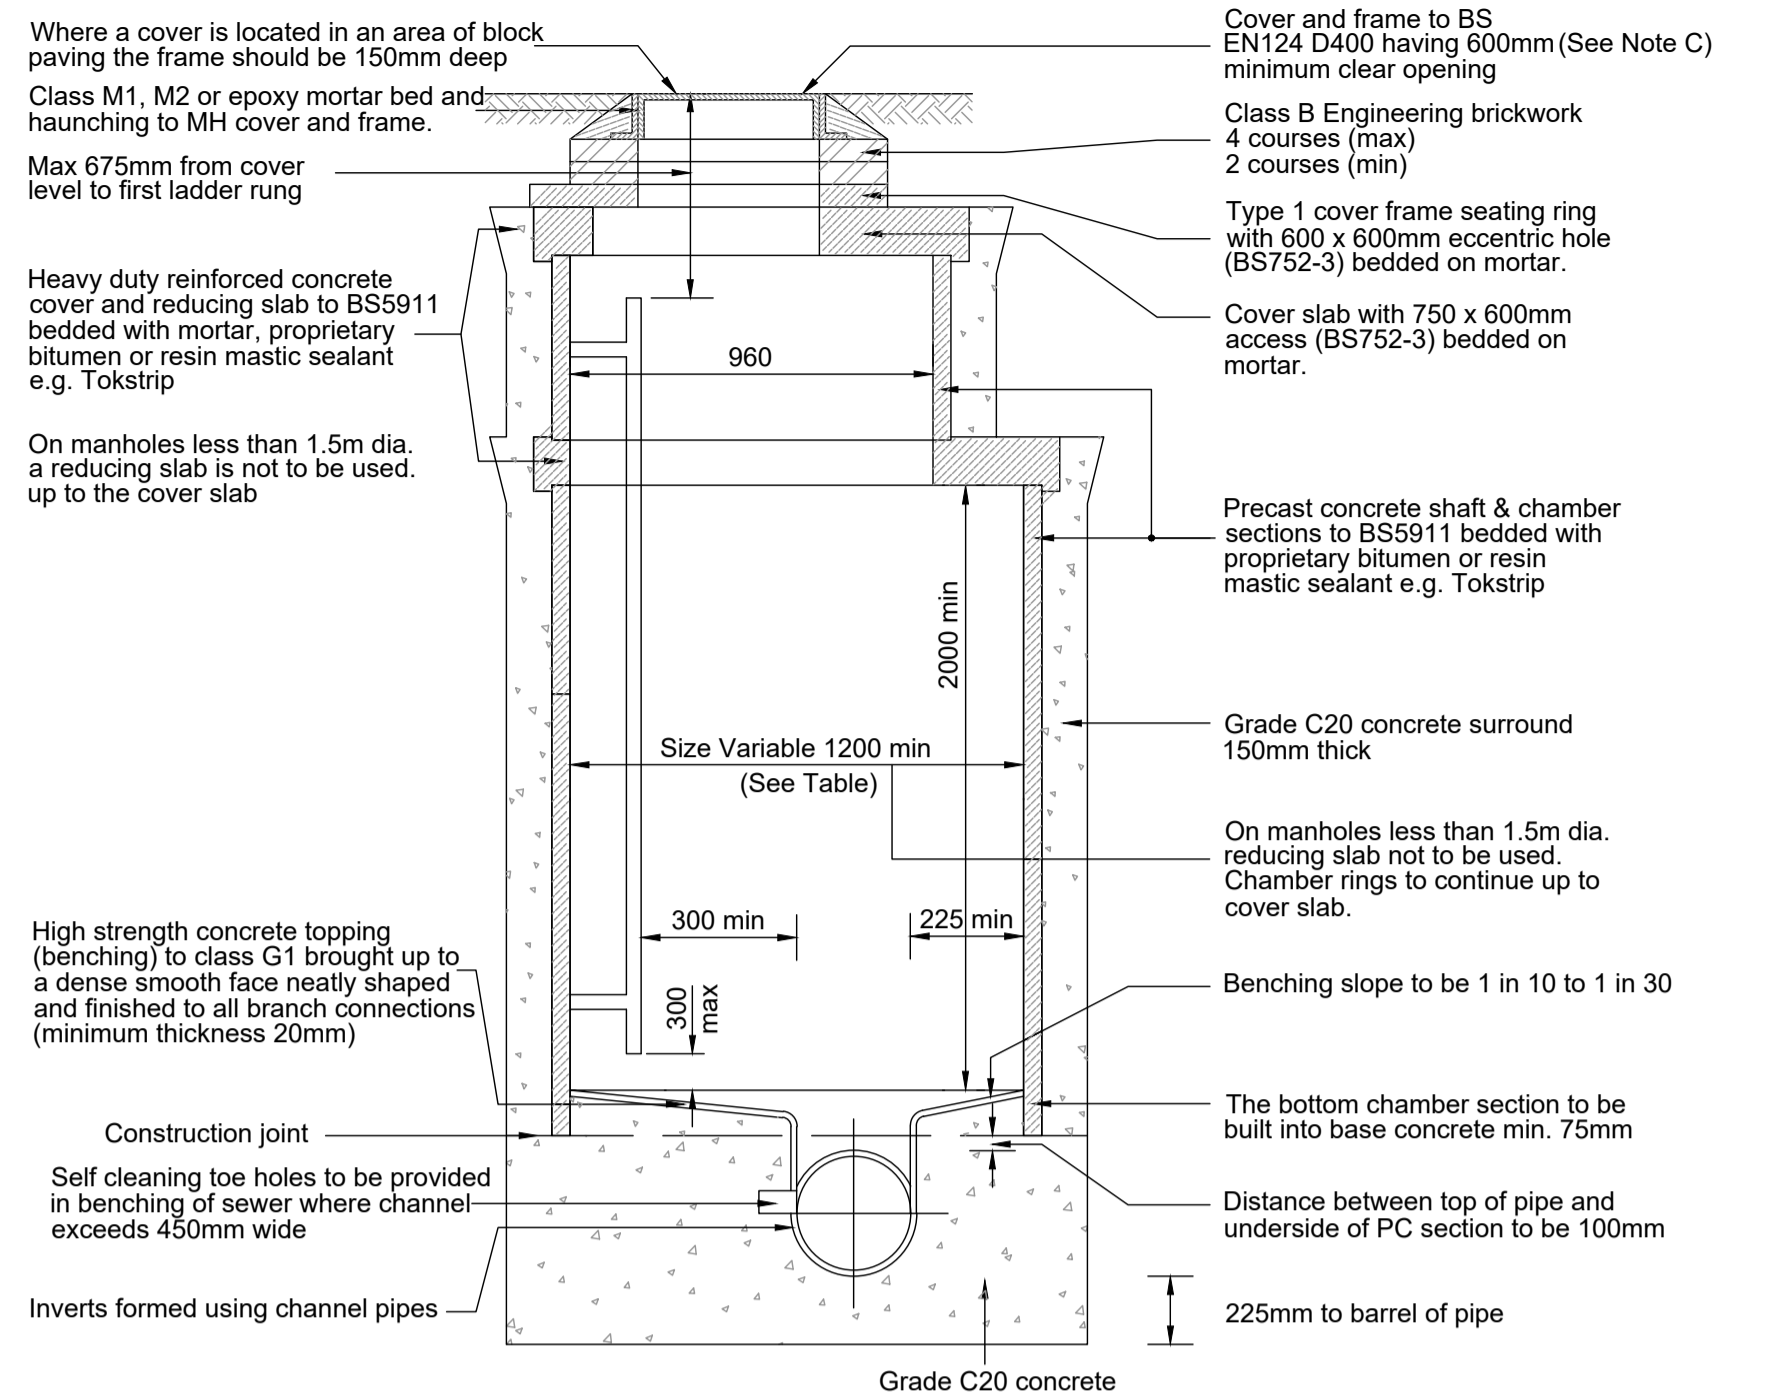


NOTE:-
FOR ALL GENERAL NOTES REFER
TO DRAWING No. HCE-1314-106.

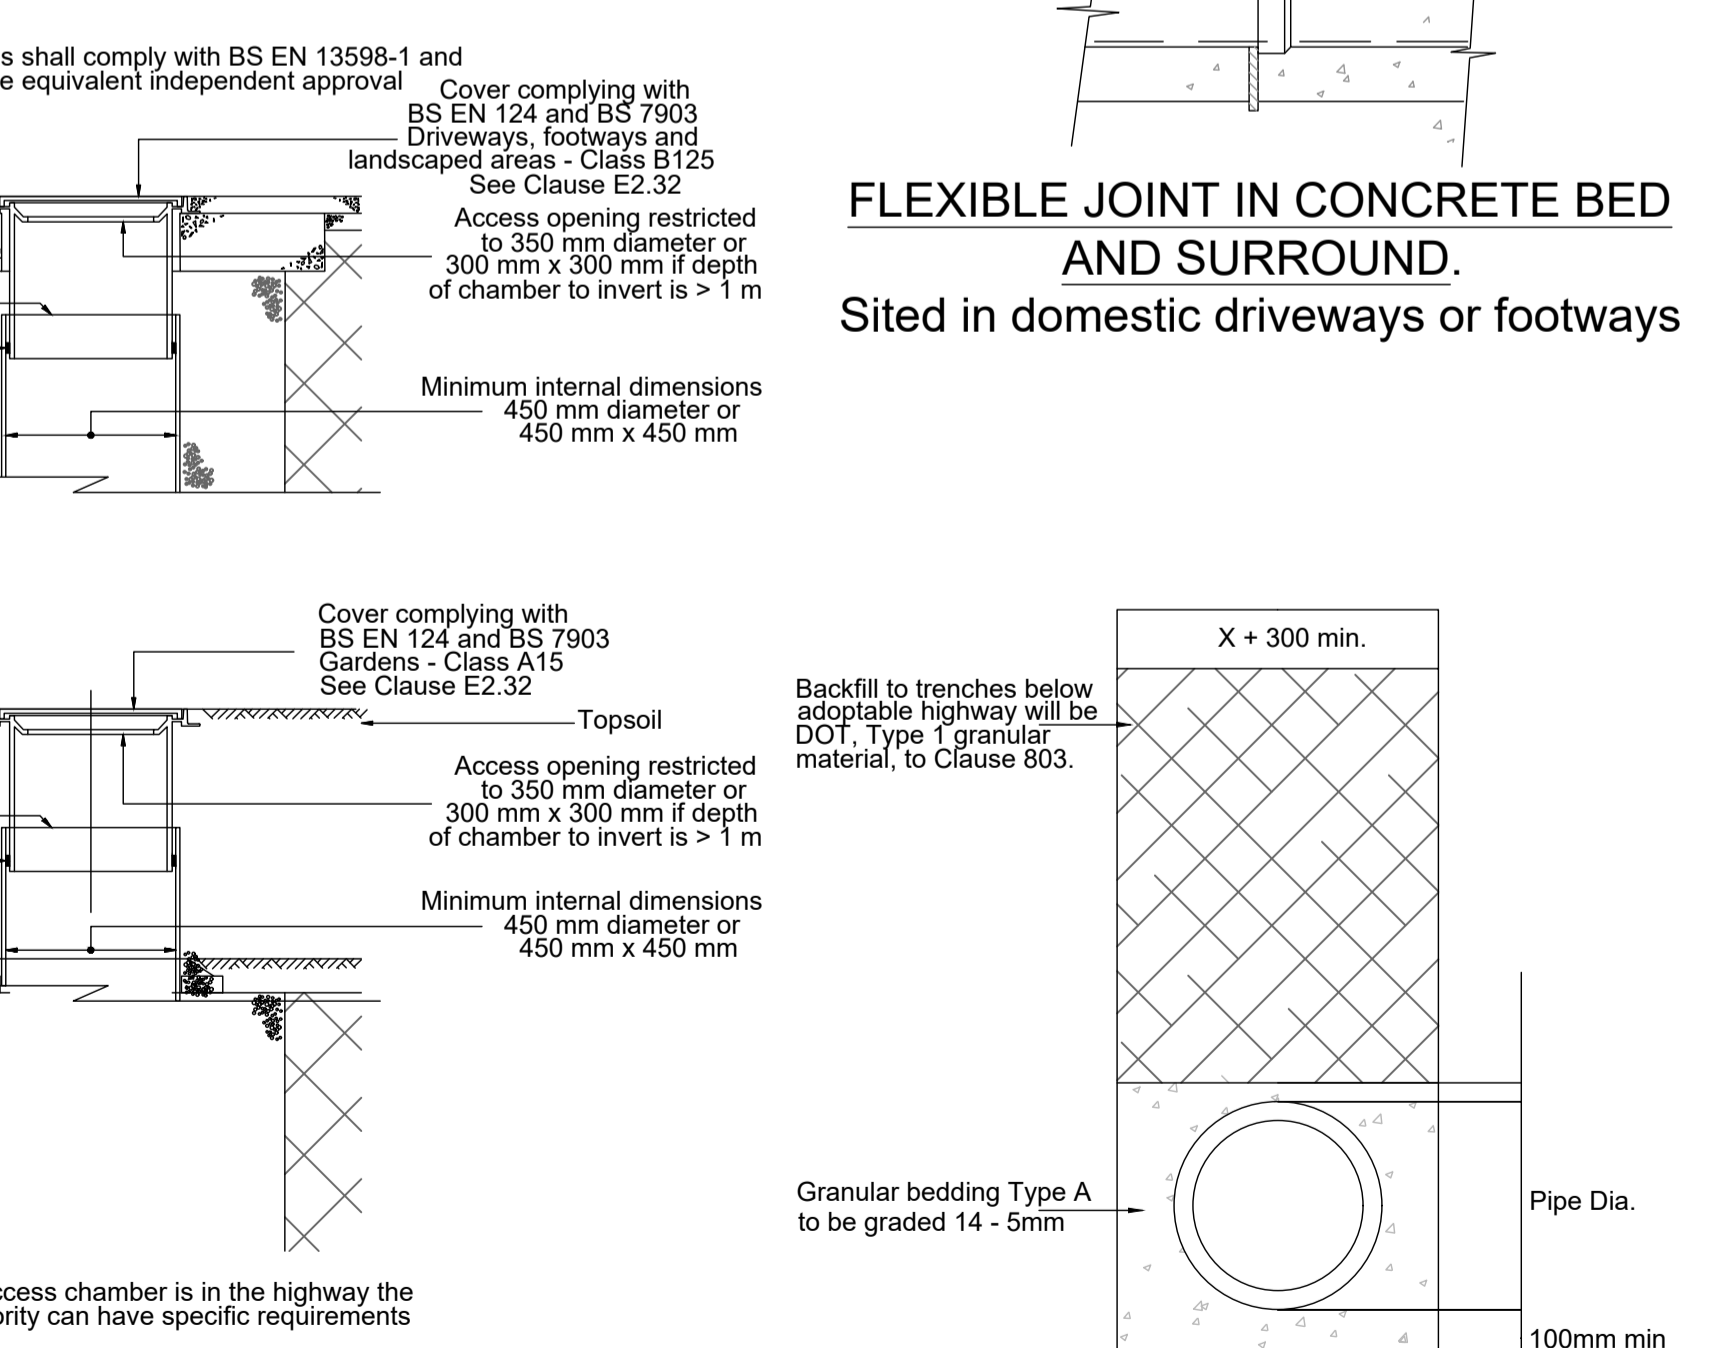


TYPICAL MANHOLE DETAIL - TYPE 2
MAX. DEPTH TO SOFFIT 3m

TYPICAL MANHOLE DETAIL - TYPE 1
DEPTH TO SOFFIT 3m to 6m

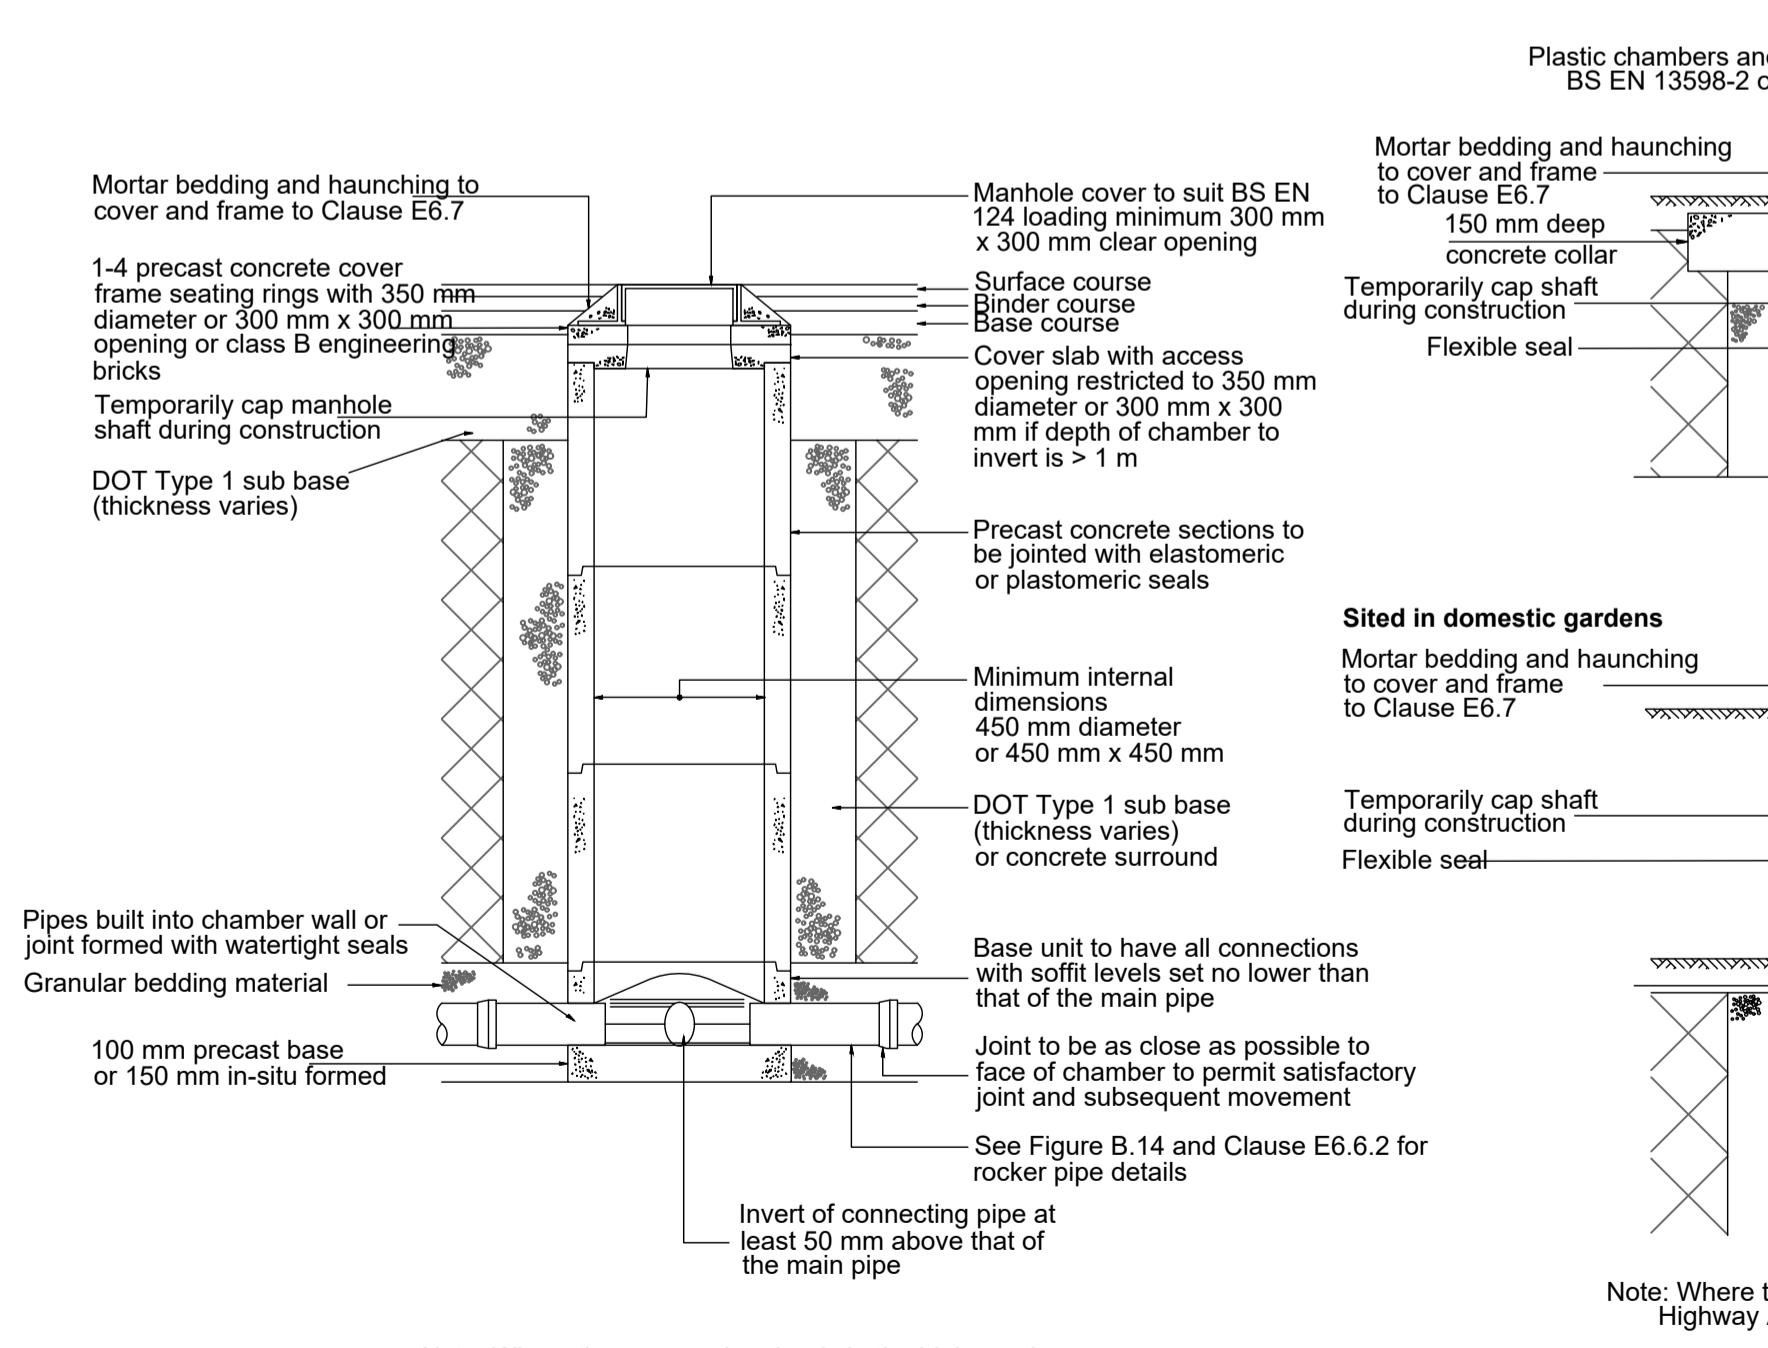


TYPICAL INSPECTION CHAMBER DETAIL - TYPE 3.
(Rigid Material Detail)
MAXIMUM DEPTH FROM COVER LEVEL TO SOFFIT OF
PIPE IN AREAS SUBJECT TO VEHICLE LOADING 3 m,
NON-ENTRY

**ALTERNATIVE TOP DETAILS FOR LIGHT VEHICLE
LOADING AND LANDSCAPED AREAS - TYPE 3**
MAXIMUM DEPTH FROM COVER LEVEL TO SOFFIT OF
PIPE IN AREAS SUBJECT TO VEHICLE LOADING 3 m,
NON-ENTRY

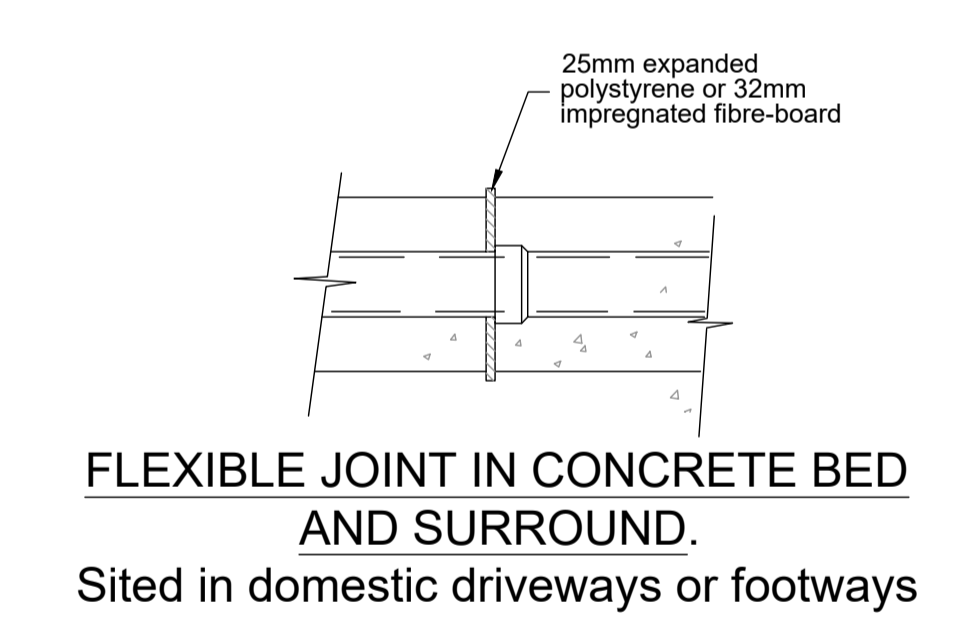

**FLEXIBLE JOINT IN CONCRETE BED
AND SURROUND.**
Sited in domestic driveways or footways

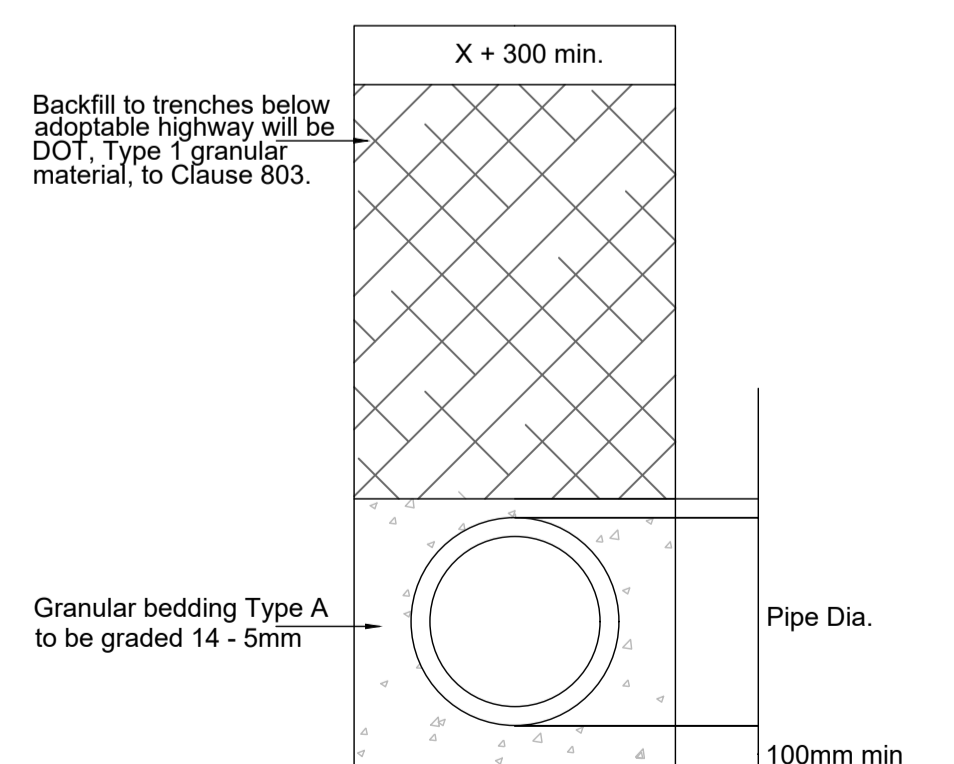


CLASS S BEDDING

TYPE	SIZE OF LARGEST PIPE (DN)	MIN. INTERNAL DIMENSIONS (1) RECTANGULAR LENGTH AND WIDTH	CIRCULAR DIAMETER	MIN. CLEAR OPENING SIZE (1) RECTANGULAR LENGTH AND WIDTH	CIRCULAR DIAMETER
MANHOLE <1.5m deep to soffit	≤ 150	750 x 675 (7)	1000 (7)	750 x 675 (2)	nc (3)
	225	1200 x 675	1200	1200 x 675 (2)	
	300	1200 x 750	1200		
>1.5m deep to soffit	>300	1800 x (DN+450)	The larger of 1800 or (DN+450)		
	≤ 225	1200 x 1000	1200	600 x 600	600
	300	1200 x 1075	1200		
MANHOLE SHAFT (4)	Steps (5)	1050 x 800	1050	600 x 600	600
	Ladder (5)	1200 x 800	1200		
	Winch (6)	900 x 800	900	600 x 600	600


Notes:
(1) Larger sizes may be required for manholes on bends or where there are junctions.
(2) May be reduced to 600 by 600 where required by highway loading considerations, subject to a safe system of work being specified.
(3) Not applicable due to working space needed.
(4) Minimum height of chamber in shafted manhole 2m from benching to underside of reducing slab.
(5) Min clear space between ladder or steps and the opposite face of the shaft should be approximately 900mm.
(6) Winch only - no steps of ladders, permanent or removable.
(7) The minimum size of any manhole serving a sewer (i.e. any drain serving more than one property) should be 1200mm x 675mm rectangular or 1200mm diameter.

TYPE	DEPTH TO INVERT FROM COVER LEVEL (m)	INTERNAL SIZES		COVER SIZES	
		RECTANGULAR LENGTH AND WIDTH	CIRCULAR DIAMETER	RECTANGULAR LENGTH AND WIDTH	CIRCULAR DIAMETER
Rodding Eye		As drain but min 100			Same size as pipework (1)
Access Fittings small 150 dia	0.6 or less, except where situated in a chamber	150x100	150	150x100 (1)	Same size as access fitting
		large 225x100	225	225x100 (1)	
Inspection Chamber	Shallow	0.6 or less	225x100	190 (2)	190 (1)
	Deep	1.2 or less >1.2 but <3.0	450x450 450x450	450 450	Min 430x430 430 Access restricted to max 350 (3)

Notes:
(1) The clear opening may be reduced by 20mm in order to provide proper support for the cover and frame.
(2) Drains upto 150mm.
(3) A larger clear opening may be used in conjunction with a restricted access. The size is restricted for health and safety reasons to deter entry.

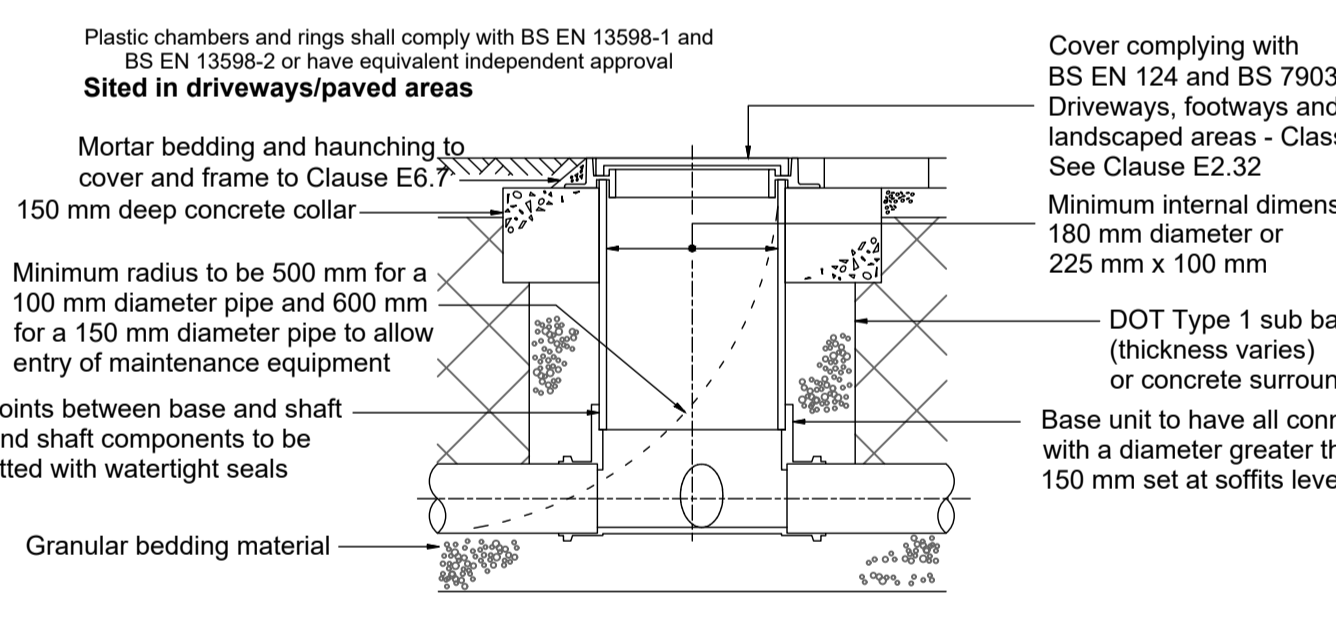

TYPICAL INSPECTION CHAMBER DETAIL - TYPE 4
(Flexible material detail)
Maximum depth from cover level to soffit of pipe 2 m, non-entry

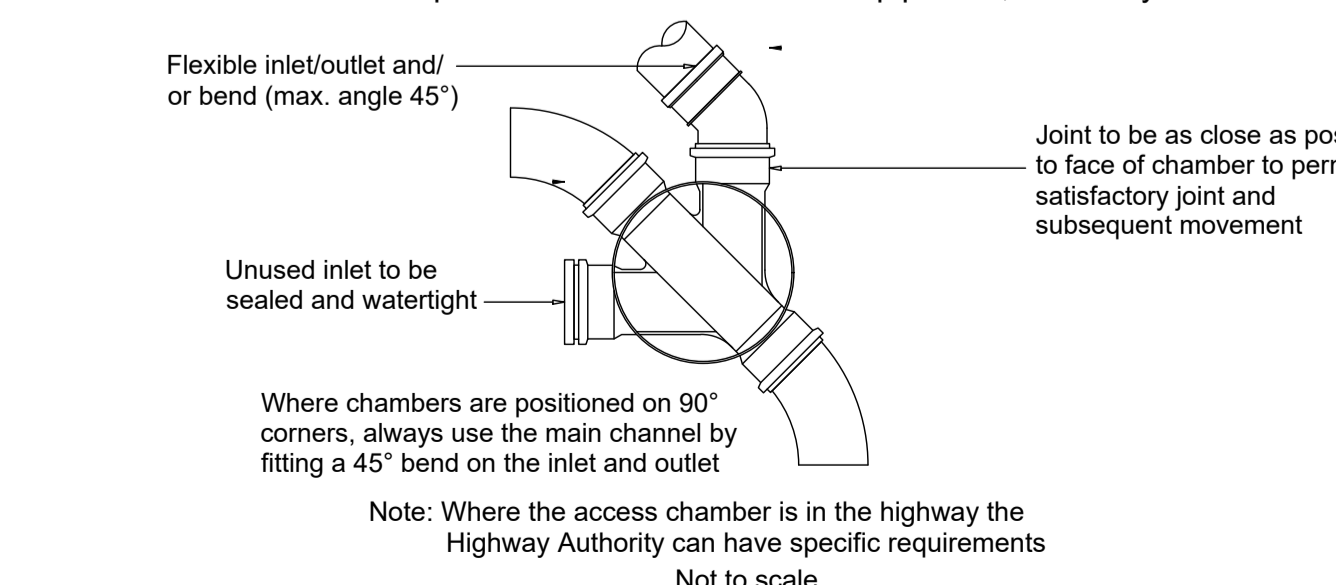

CLASS S BEDDING

REV	DATE	BY	DESCRIPTION	CHK	APPD

DRAWING STATUS:

HCE HCE Limited
Canolfan Gorseion Centre
Millers Drive
Gorseion
SA4 4QN
Civil Engineering
Structural Engineering
Structural Surveys
Project Management
Petrochemical
Tel: 01792 805010
Email: info@hcelimited.com
Web: www.hcelimited.com

CLIENT: **RPM Ltd**

ARCHITECT: **THOMAS LOGIN ARCHITECTURE**

PROJECT: **MARGAM TRUCK STOP
TYN Y CAEU, MARGAM**

TITLE: **STANDARD MANHOLE DETAILS
DRAINAGE DETAILS SHEET 1**

SCALE @ AT:	CHECKED:	APPROVED:
N.T.S.	IH	IH
CAD FILE:	DESIGN DRAWN:	DATE:
HCE-1374-SK02	MJ	May 2020
PROJECT No:	DRAWING No:	REV:
1374	SK02	R02