


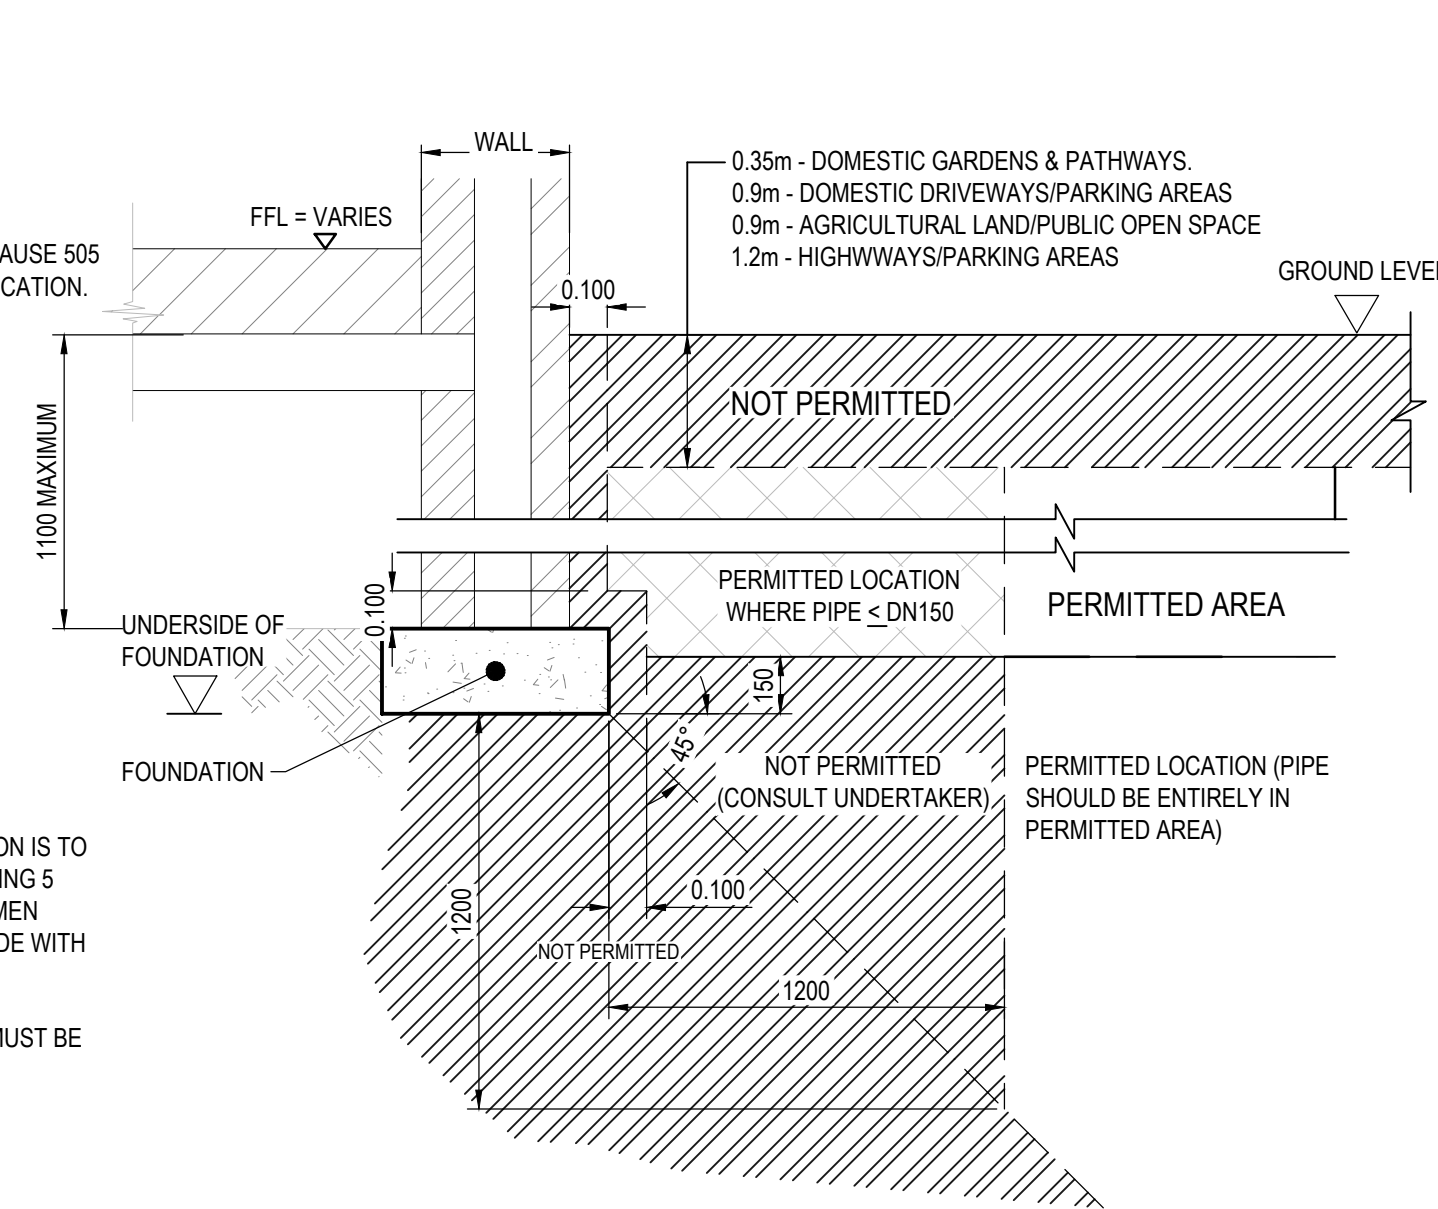

CONCRETE BED AND SURROUND
(BEDDING FACTOR = 2.6)

6. WHERE PIPES WITH FLEXIBLE JOINTS ARE USED, THE CONCRETE PROTECTION IS TO BE INTERRUPTED OVER ITS FULL CROSS SECTION AT INTERVALS NOT EXCEEDING 5 METRES (OR AS DIRECTED BY THE ENGINEER) BY A SHAPED FORMER OF BITUMEN IMPREGNATED COMPRESSIBLE FILLER. THESE INTERRUPTIONS SHALL COINCIDE WITH PIPE JOINTS. SEE DIMENSIONS FOR PIPE BEDDING TABLE FOR THICKNESS OF COMPRESSIBLE FILLER.


7. CONCRETE TO BE GRADE GEN 3. WHERE FLEXIBLE PIPES ARE USED, CARE MUST BE TAKEN

8. TO PREVENT THE PIPES FROM FLOATING.

SCALE 1:20

TYPICAL DRAINAGE DETAIL IN CLOSE
PROXIMITY OF FOUNDATIONS
(DETAIL IN ACCORDANCE WITH SFA FIGURE B1)



NTS

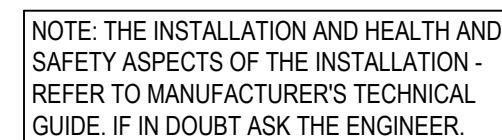

SCALE: NTS



SCALE 1:20

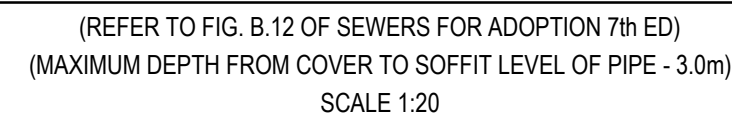

N.T.S

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
2. ALL LEVELS ARE SHOWN IN METRES UNLESS NOTED OTHERWISE.
3. DO NOT SCALE FROM THE DRAWING. USE FIGURED DIMENSIONS ONLY.
4. ANY DISCREPANCIES TO BE REPORTED IMMEDIATELY TO THE ENGINEER.
5. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS, ENGINEERS, SUBCONTRACTORS AND SPECIALISTS DRAWINGS AND SPECIFICATIONS.
6. EXISTING SERVICES HAVE NOT BEEN SHOWN BUT ARE PRESENT - THE CONTRACTOR IS TO LIAISE WITH ALL STATUTORY AUTHORITIES PRIOR TO THE COMMENCEMENT OF ANY WORKS.

DRAWING STATUS
A - Approval, AB - As-Built, C - Construction, D - Draft, P - Preliminary, T - Tender